

# **SPECIFICATIONS**

## **PARTICLE SENSOR**

### **KS-42B**



3-20-41 Higashimotomachi, Kokubunji, Tokyo 185-8533, Japan

# Outline

The KS-42B is a sensor which uses the light-scattering method for measuring the particle number concentration in liquid. The particle count is determined for various sizes.

By connecting the KS-42B to the controller KE-40B1, a liquid-borne particle counter system with five size ranges ( $\geq 0.2 \mu\text{m}$ ,  $\geq 0.3 \mu\text{m}$ ,  $\geq 0.5 \mu\text{m}$ ,  $\geq 1.0 \mu\text{m}$ ,  $\geq 2.0 \mu\text{m}$ , (factory default setting)) can be created. Using the KE-40B1, it is also possible to freely specify the size ranges for particle detection.

The KS-42B does not have measurement controls or a display for measurement results. It is designed to be used under control of a separate controller KE-40B1 which also supplies power to the KS-42B. The KS-42B incorporates a leak sensor. If a leak is detected, an alarm output can be activated. As the KS-42B does not incorporate a flow control circuit for the sample fluid, the flow rate of the sample fluid must be controlled by external means. The rated sample fluid flow is 10 mL per minute.

## Specifications

Optical system	Sideway light scattering method
Light source	Laser diode (rated output 40 mW; wavelength 780 nm)
Laser product class	Class 1, IEC 60825-1:2014 Internal particle detection mechanism uses Class 3B laser
Light detector	PIN type photodiode
Materials of parts exposed to sample	Synthetic quartz, PFA, PTFE
Allowable sample type	Fluids which do not corrode the fluid contact materials
Calibration	By polystyrene latex (PSL) particles with refractive index 1.6 in pure water
Minimum detectable particle size	0.2 $\mu\text{m}$
Measurable particle size range	0.2 $\mu\text{m}$ to 5 $\mu\text{m}$ (with PSL particles of refractive index 1.6 in pure water)

Size range	<p>Freely settable to 0.2 <math>\mu\text{m}</math> to 2 <math>\mu\text{m}</math></p> <p>(The ranges can be set to 0.2 <math>\mu\text{m}</math> to 0.5 <math>\mu\text{m}</math> in 0.01 <math>\mu\text{m}</math> steps, and can be set to 0.5 <math>\mu\text{m}</math> to 2 <math>\mu\text{m}</math> in 0.1 <math>\mu\text{m}</math> steps. The setting is up to 10 channels and done by controller KE-40B1. Upper limit for smallest particle size channel (CH 1) is 0.49 <math>\mu\text{m}</math>)</p> <p>*The factory default setting is five channels (<math>\geq 0.2 \mu\text{m}</math>, <math>\geq 0.3 \mu\text{m}</math>, <math>\geq 0.5 \mu\text{m}</math>, <math>\geq 1 \mu\text{m}</math>, <math>\geq 2 \mu\text{m}</math>)</p>
Counting efficiency	<p>70% to 110%</p> <p>(measuring PSL particles in the range with 2 to 3 times larger than the minimum detectable particle size, using count of 0.2 <math>\mu\text{m}</math> and above for comparison with reference unit)</p>
Flow rate	10 mL/min
Maximum particle number concentration	1200 particles/mL (coincidence loss 5% for 0.2 $\mu\text{m}$ particles)
Sample temperature range	+15°C to +35°C (no moisture condensation on flow cell)
Sample pressure range	300 kPa or less (gauge pressure)
Warm-up time	About 10 minutes
Sample inlet/outlet	
INLET	Sample inlet, 2 mm $\times$ 4 mm dia. flared tube joint
OUTLET	Sample outlet, 2 mm $\times$ 4 mm dia. flared tube joint
Purge air port	
PURGE	Purge gas inlet, Rc 1/8 (1/8 PT female)
Indicators	Two color light emitting diode
PARTICLE MONITOR	Briefly flashes green when particles above minimum detectable particle size are detected
LIQUID LEAK	<p>Lit (green) when leak is not detected within chassis</p> <p>Lit (red) when leak is detected within chassis</p>
CELL	<p>Lit (green) during normal operation</p> <p>Lit (red) when flow cell is contaminated or particle number concentration in sample fluid exceeded maximum particle number concentration</p> <p>Off when light source is off</p>
LASER	<p>Lit (green) during normal operation</p> <p>Flashing (red) when light source output is the rated level or below</p> <p>Off when light source is off</p>
POWER	Lit (green) while power to unit is on

## Input/output connectors

CONTROLLER For connection of controller KE-40B1

### LIQUID LEAK ALARM

Shorted during normal operation, open when internal leak is detected (M3 screw terminal, accepts either electric wire with a 1.25 mm<sup>2</sup> cross section or spade (Y-type) terminals)

Maximum load: 30 V DC, 1 A or less

Power 12 V DC (supplied via controller KE-40B1)

## Electric power consumption

6 VA

## Installation inclination angle

Max. 2°

## Environmental Requirements

### Operation Environments

Indoor Use Only

Altitude Up to 2000 m

Overvoltage Category II (when connected to controller KE-40B1)

Pollution Degree 2

Protection Class I

## Environmental conditions for operation

+15°C to +35°C, 80% RH or less (no condensation)

## Environmental conditions for storage

−10°C to +50°C, 90% RH or less

(no condensation and no freezing in internal piping)


Dimensions 135.2 mm (H) × 245 mm (W) × 179 mm (D) (maximum)

125 mm (H) × 240 mm (W) × 151 mm (D) (excluding protruding parts)


Weight Approx. 3.2 kg

Supplied Accessories	Tube A vacuum pack	1
	(2 mm × 4 mm dia., 1.5 m flared PFA tube 2, union joint 1)	
	Connection cable A (1 m) KS-42-121	1
	Instruction manual	1
	Instruction sheet for “Transport and Installation”	1
	Liquid-borne particle counter usage precautions	1
	Inspection certificate	1


Option Connection cable B (5 m) KS-42-123

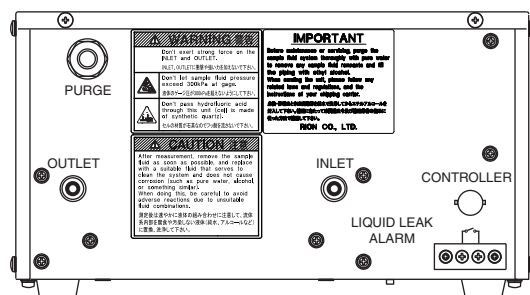


Rear View

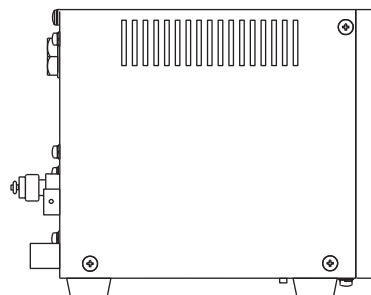


Left Side View

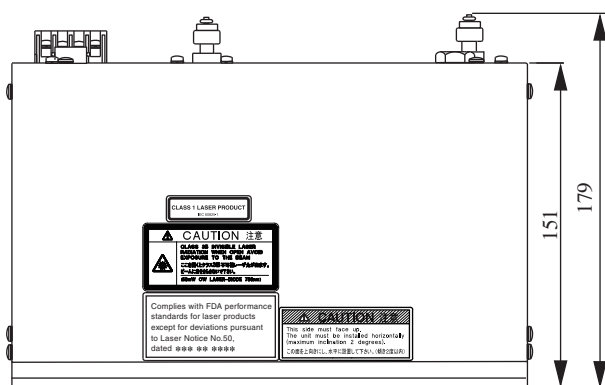

Top View

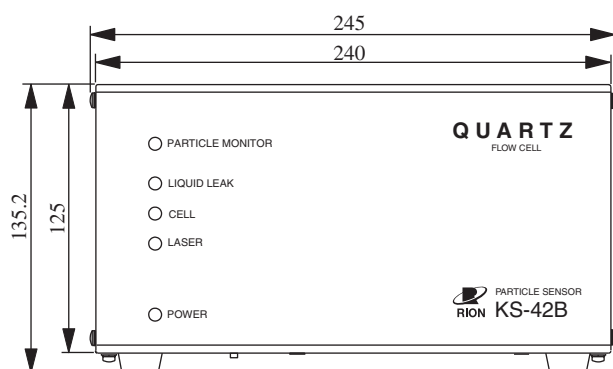

Front View

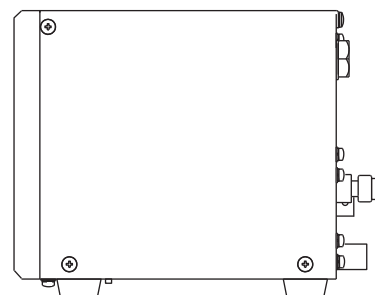

Right Side View

Unit: mm

## Dimensional Drawings

Specifications subject to change without notice